

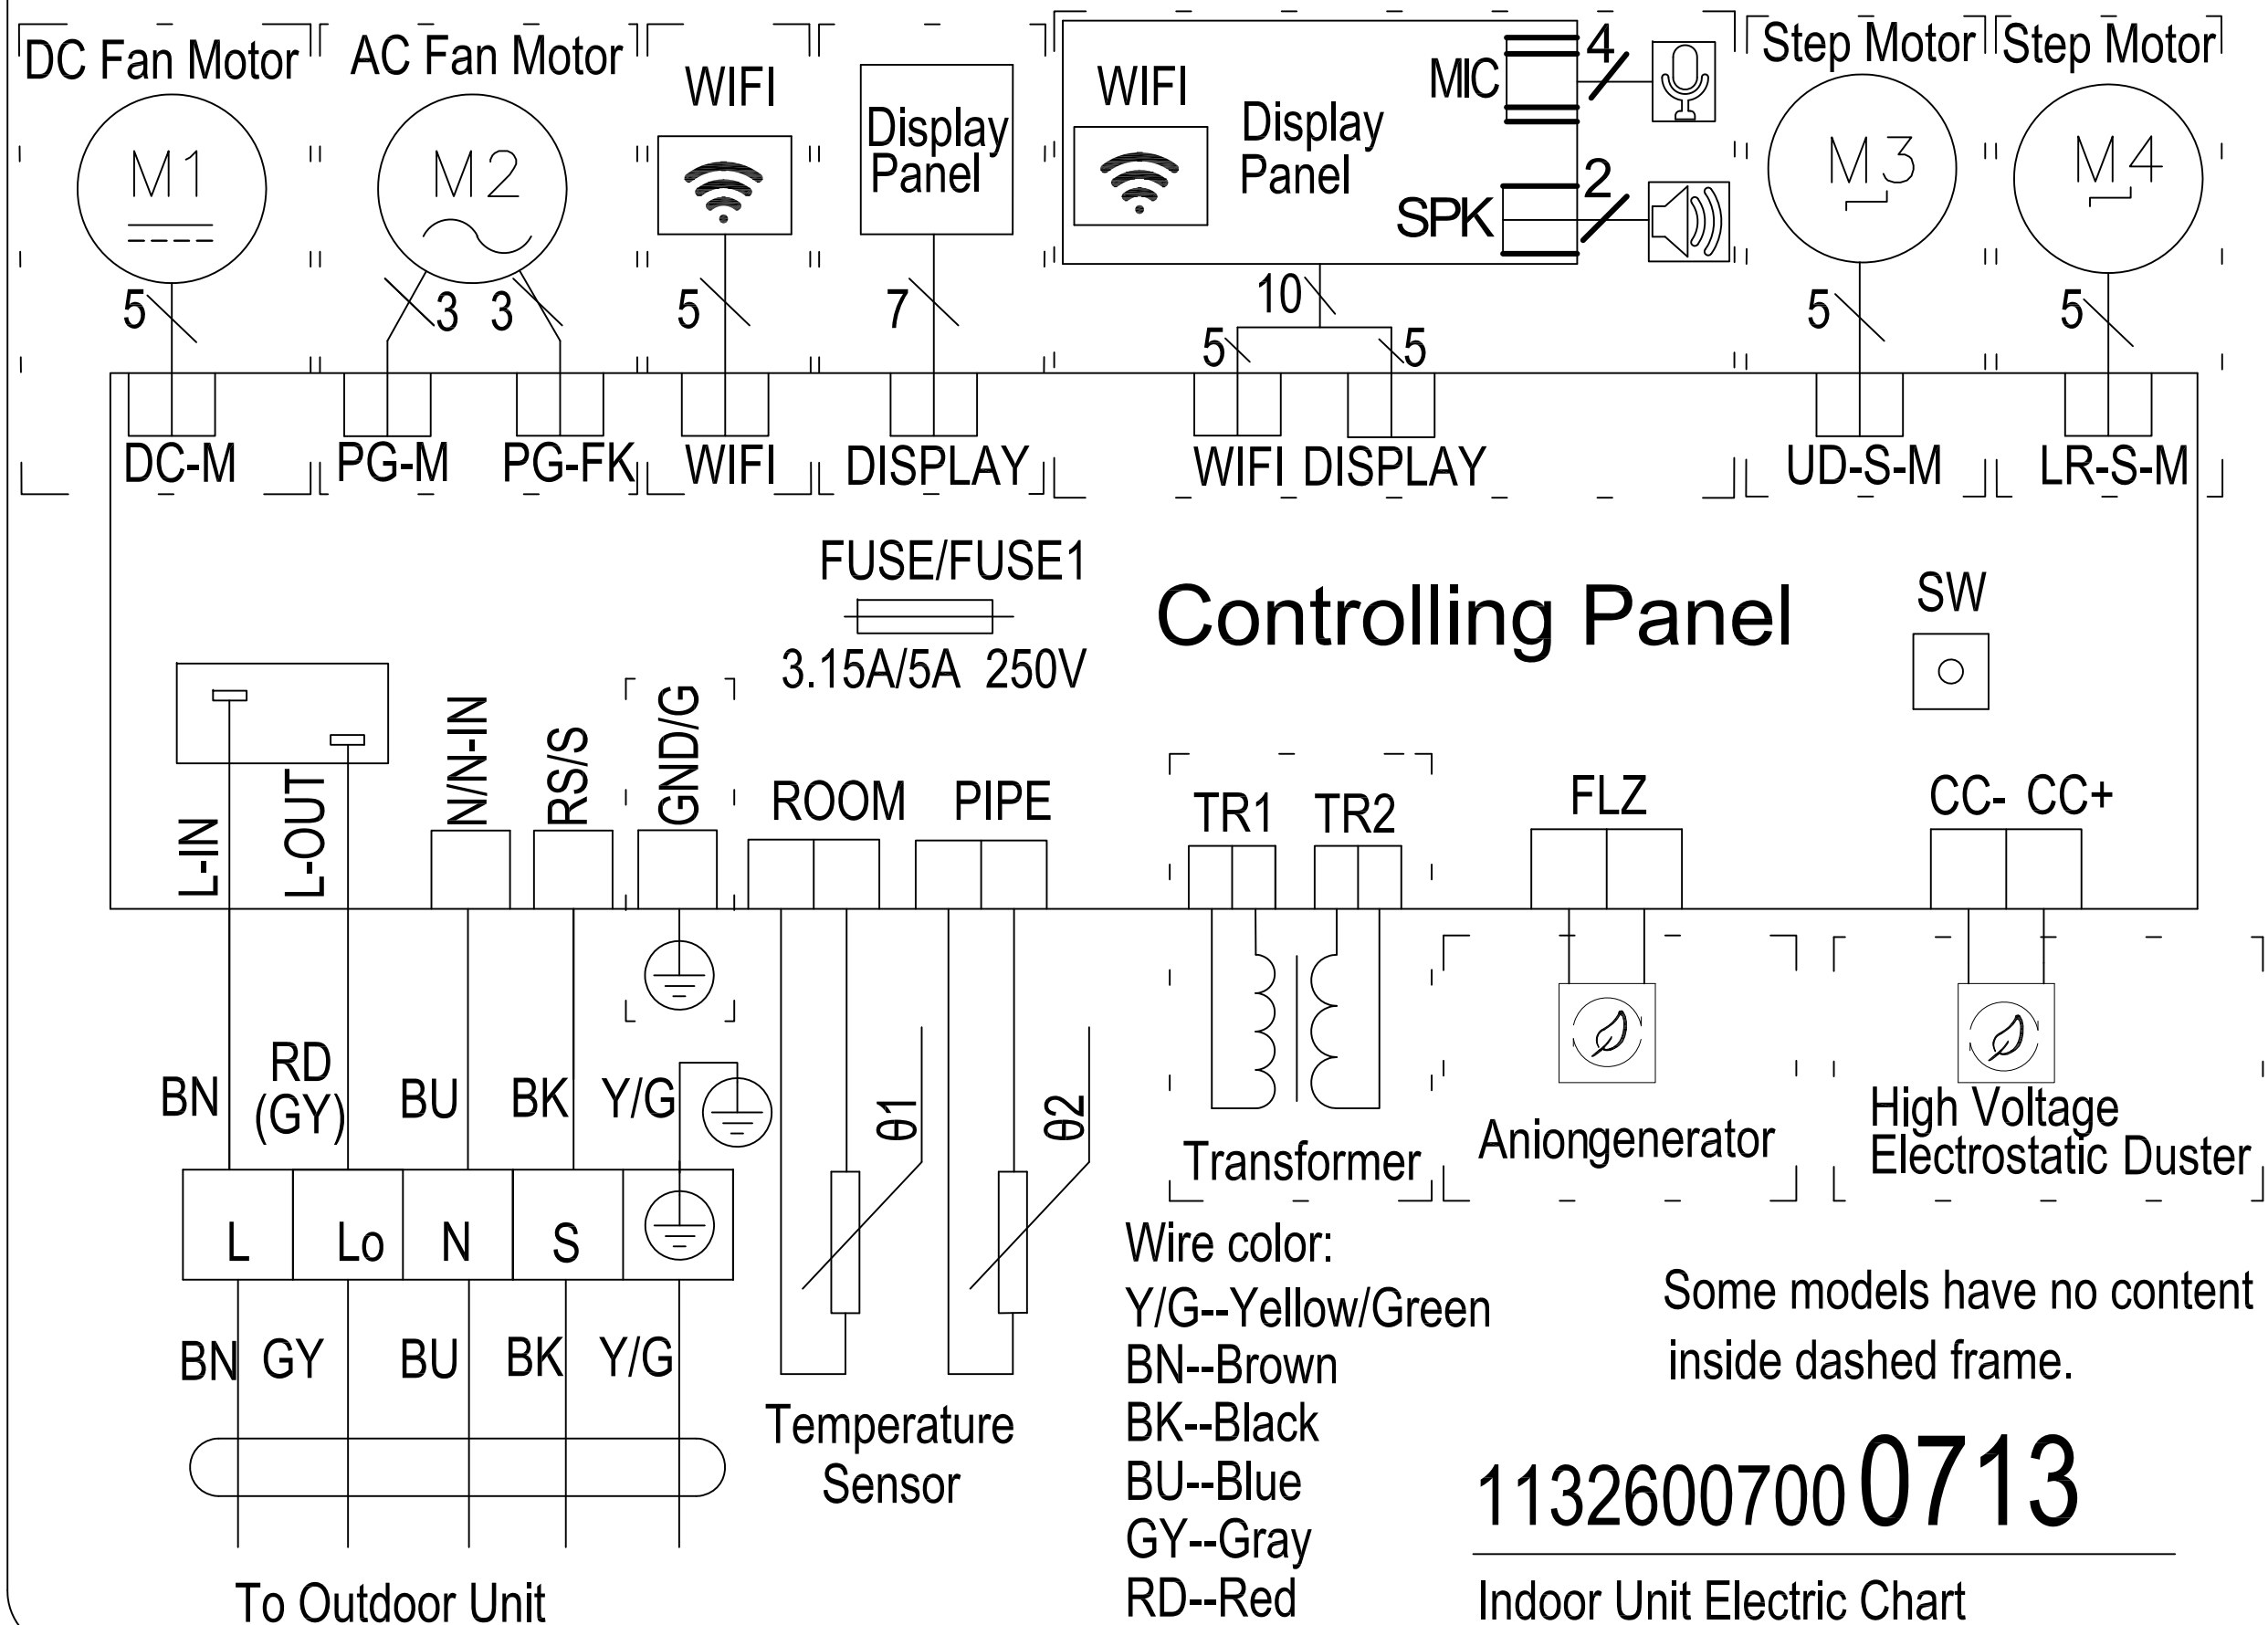


NOTE:if used as MONO unit, for the standby control needs, the cross section area of cable connected to L,Lo,N,S must be sufficient for the maximum system current. The maximum system current is equal to the sum of indoor unit and outdoor unit rated current if used as MULTI unit Lo on the terminal block does not need to be connected.

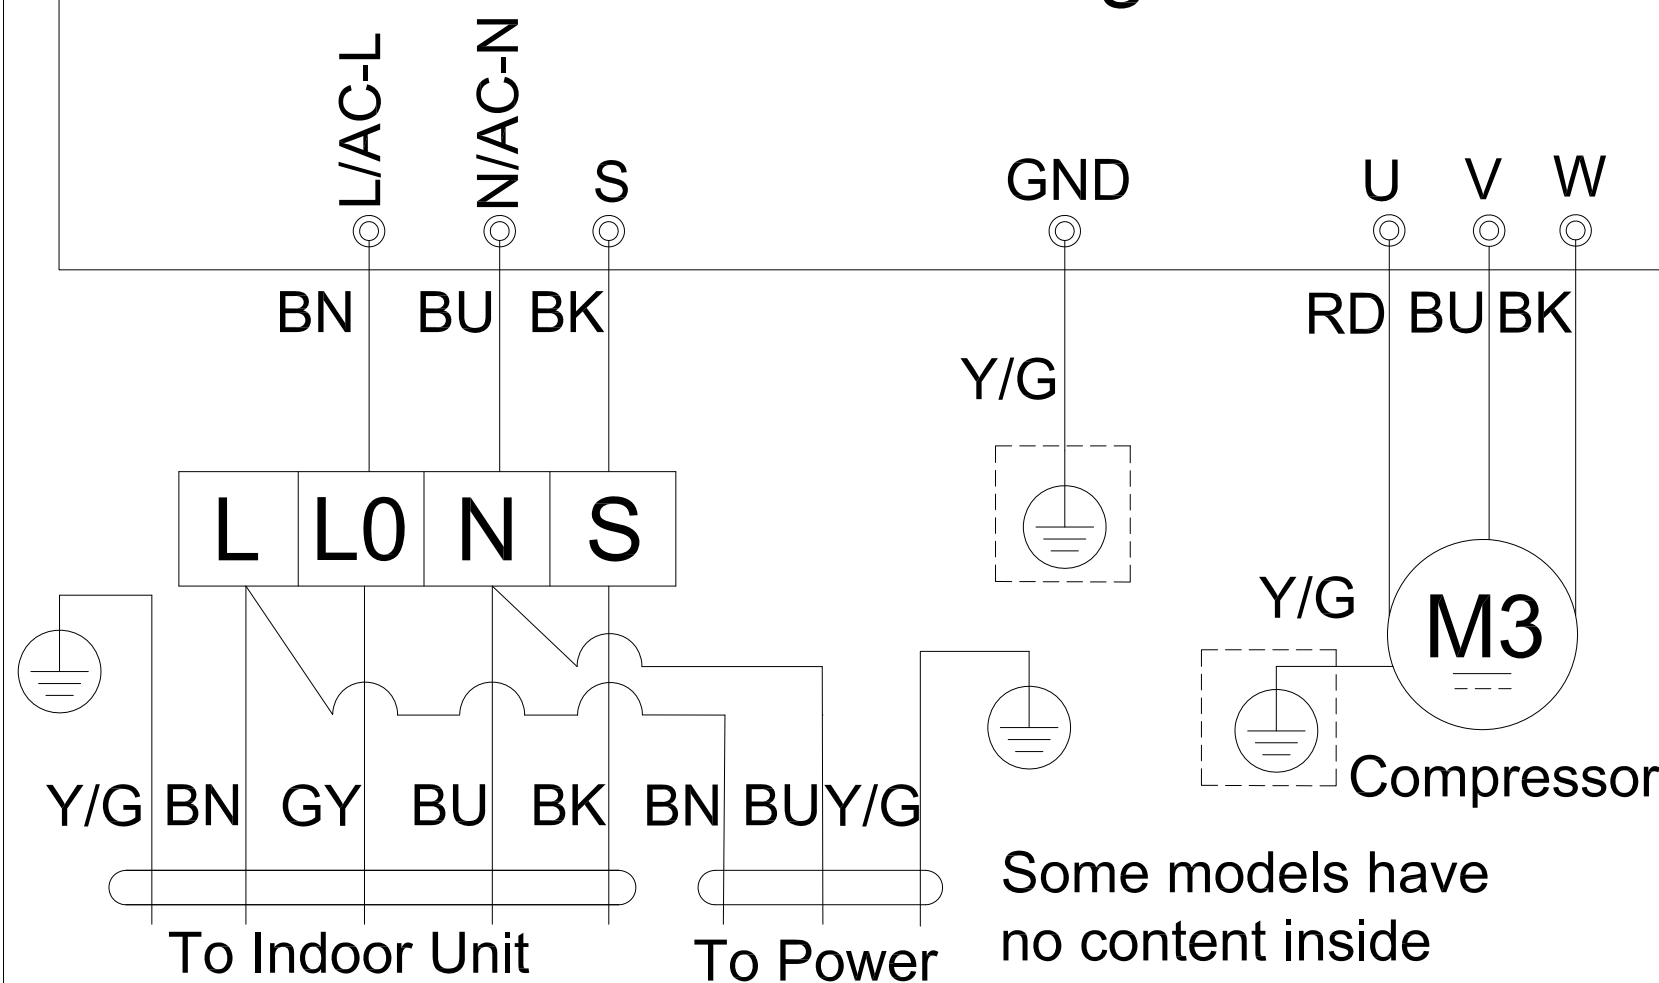

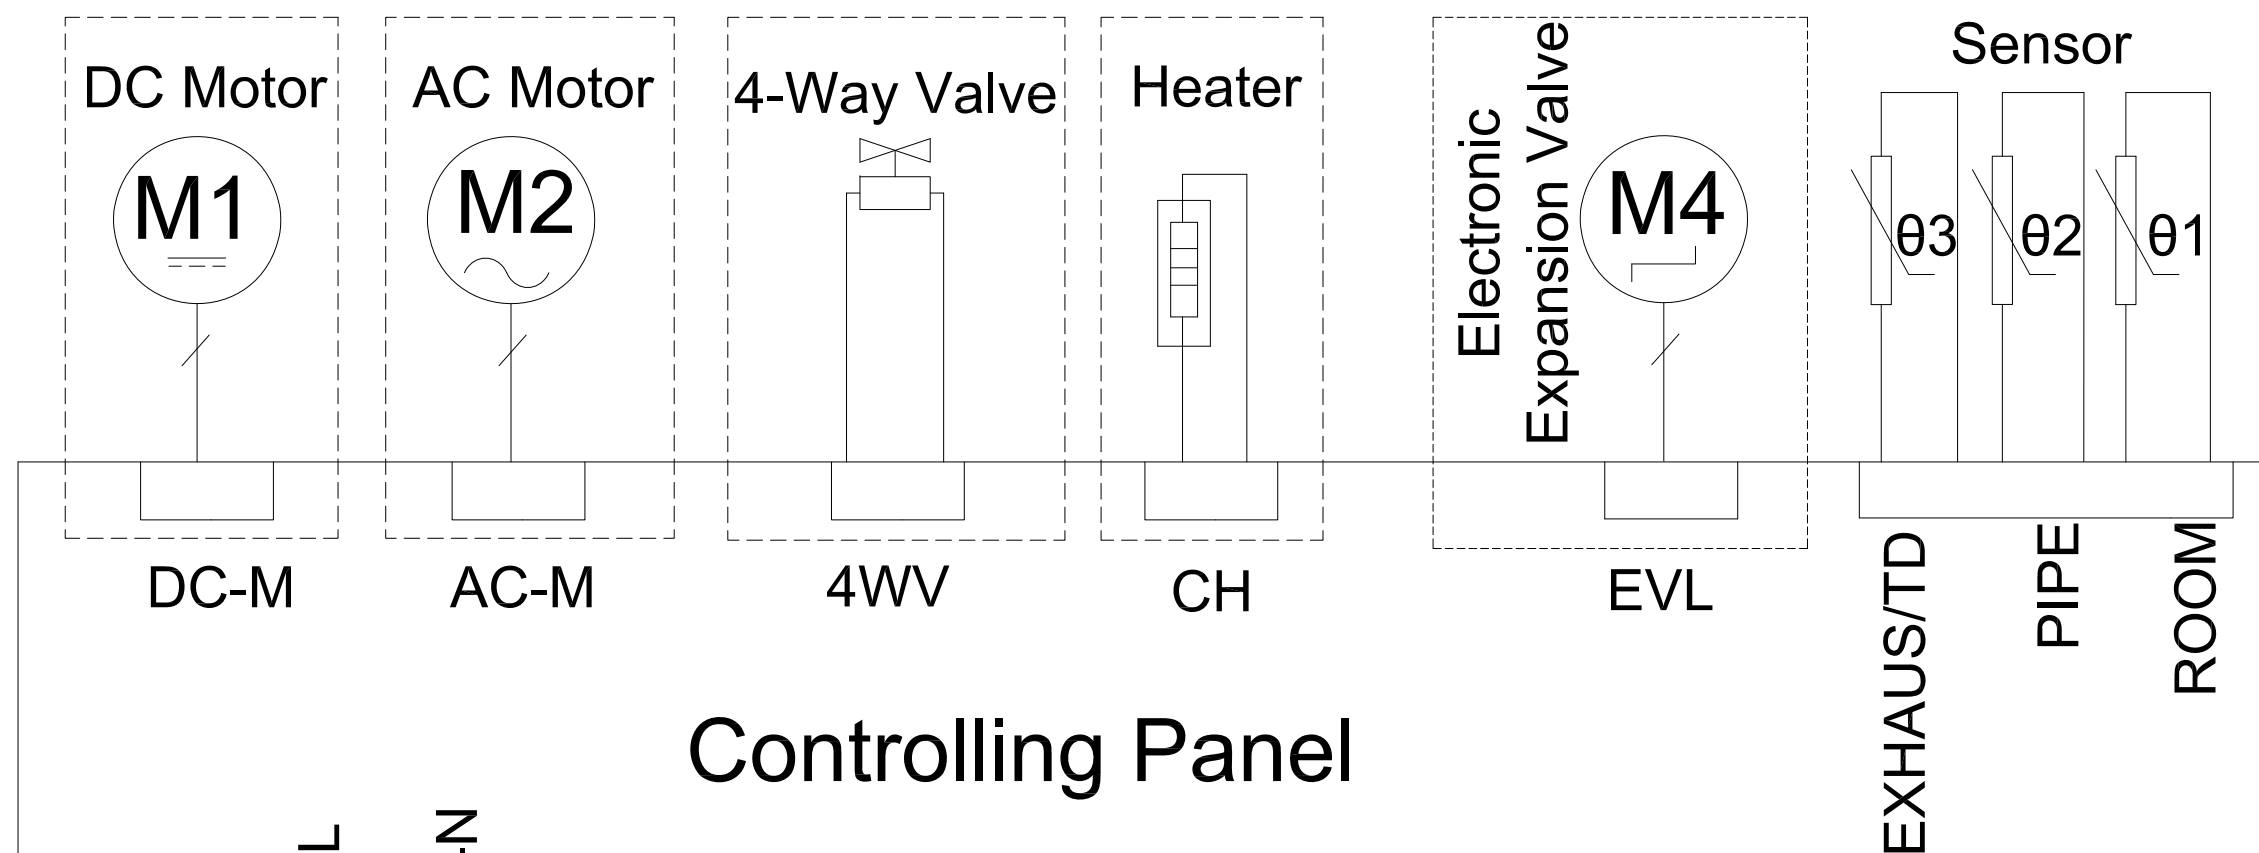

Wire color:
Y/G-Yellow/Green
BN-Brown
BK-Black
BU-Blue
GY-Gray
RD-Red

Some models have
no content inside
dashed frame.

1132600700 **0748**
Outdoor Electrical Wiring Diagram